

**ASTM E 1886 and ASTM E 1996  
TEST REPORT**

**Rendered to:**

**NORSE, INC.**

**SERIES/MODEL: Flush Mount/Surface Mount  
PRODUCT TYPE: Hurricane Shutter Fastening System**

**This report contains in its entirety:**

**Cover Page: 1 page  
Report Body: 16 pages  
Test Equipment: 1 page  
Sketches: 5 pages  
Photograph: 1 page  
Drawings: 7 pages**

**Report No.: 92518.01-109-44  
Revision 1: 09/21/09  
Test Dates: 08/17/09  
Through: 08/23/09  
Report Date: 09/11/09  
Expiration Date: 08/23/13**

**ASTM E 1886 and ASTM E 1996 TEST REPORT**

Rendered to:

NORSE, INC.  
100 South Road  
Torrington, Connecticut 06790

Report No.: 92518.01-109-44  
Revision 1: 09/21/09  
Test Dates: 08/17/09  
Through: 08/23/09  
Report Date: 09/11/09  
Expiration Date: 08/23/13

**Project Summary:** Architectural Testing, Inc. was contracted by Norse, Inc. to perform testing on three Series/Model Flush Mount and Series/Model Surface Mount, hurricane shutter fastening system. The samples tested met the performance requirements set forth in the referenced test procedures for a  $\pm 2155$  Pa ( $\pm 45.0$  psf) Design Pressure with missile impacts corresponding to Missile Level D and Wind Zone 4. Test specimen description and results are reported herein. The samples were provided by the client.

**Test Procedures:** The test specimens were evaluated in accordance with the following:

*ASTM E 330-02, Test Method for Structural Performance of Exterior Windows, Curtain Walls and Doors by Uniform Static Air Pressure Difference.*

*ASTM E 1886-05, Standard Test Method for Performance of Exterior Windows, Curtain Walls, Doors and Storm Shutters Impacted by Missile(s) and Exposed to Cyclic Pressure Differentials.*

*ASTM E 1996-05, Standard Specification for Performance of Exterior Windows, Glazed Curtain Walls, Doors and Storm Shutters Impacted by Wind Borne Debris in Hurricanes.*



## Test Specimen Description: (Continued)

### Installation Details:

**Flush Mount Installation:** The shutter system was installed into a concrete-masonry-unit (CMU) grout filled wall. Steel hooks, measuring 1-3/8" wide by 1" tall by 0.07" thick were secured to the lintel with two #10 x 2" long Tapcon concrete anchors, (Reference Norse drawing). The hooks were located on the lintel, 4" from each CMU jambs and spaced approximately 9" on center (eight total clips, four per panel). Receiving clips for the hooks were located on the plywood panel at each hook location. The receiving clips were secured with two #10 x 1" long machine bolts with nuts and washers.

**Surface Mount Installation:** The shutter system was installed onto the exterior surface of a concrete-masonry-unit (CMU) grout filled wall. Steel hooks, measuring 1-3/8" wide by 1" tall by 0.07" thick were secured to the lintel with two #10 x 2" long Tapcon concrete anchors, (Reference Norse drawing). The hooks were located on the lintel, 4" from each CMU jambs and spaced approximately 7" on center (ten total clips, five per panel). Receiving clips for the hooks were located on the plywood panel at each hook location. The receiving clips were secured with two #10 x 1" long machine bolts with nuts and washers.

*The following installation details apply to both  
Flush Mount and Surface Mount test specimens.*

The left and right sides of the plywood were secured with a "keyed-hooking" system, (Reference Norse drawing). Four clips were utilized on each side, located 8" from the head and sill and spaced approximately 21-1/2" on center. The "keyed-hooks" were secured to the plywood sheathing with four #10 x 5/8" long pan head screws. The receiving clip for the "keyed-hooks" was secured to the CMU jambs with two #10 x 2" long Tapcon concrete anchors. The vertical joint four of the "keyed-hooks", located 8" from the head and sill and spaced approximately 21-1/2" on center. The "keyed-hooks" were secured to the plywood sheathing with four #10 x 5/8" long pan head screws. The receiving clip for the "keyed-hooks" was secured to the plywood sheathing with two #10 x 1" long machine bolts with nuts and washers.

The bottom of the plywood was secured with 0.12" thick steel L-shaped clips measuring 1-1/2" wide by 1" wide and tall. The clips were located 4" from each end and spaced approximately 13-1/2" on center. The clips were secured to the plywood with two #10 x 5/8" long pan head screws through the clips and into the plywood. The clip was also secured to the poured concrete sill with one #1/4 x 1-1/2" long hex head lag bolt with concrete anchor, (Reference Norse Drawing).

**Test Results:** The following results have been recorded:

**Protocol ASTM E330-02, *Static Air Pressure Tests***

**Test Unit #1 (Flush Mount)**

**Design Pressure:  $\pm 45.0$  psf**

Title of Test	Results								
	Indicator Readings (inch)								
	#1	#2	#3	#4	#5	#6	#7	#8	#9
Structural Loads									
50% of Test Pressure (+33.75 psf)									
Maximum Deflection	0.17	1.61	0.14	0.17	0.15	0.15	0.25	0.32	0.25
Permanent Set	0.04	0.15	0.02	0.02	0.02	0.01	0.02	<0.01	<0.01
Design Pressure (+45.00 psf)									
Maximum Deflection	0.18	2.05	0.18	0.22	0.19	0.18	0.32	0.35	0.32
Permanent Set	0.03	0.19	0.03	0.02	0.01	<0.01	0.02	0.08	0.02
50% of Test Pressure (-33.75 psf)									
Maximum Deflection	0.57	2.00	0.30	0.45	0.34	0.28	0.39	0.55	0.41
Permanent Set	0.11	0.36	0.06	0.07	0.07	0.07	0.09	0.16	0.10
Design Pressure (-45.00 psf)									
Maximum Deflection	0.73	2.44	0.40	0.55	0.42	0.36	0.50	0.72	0.51
Permanent Set	0.16	0.43	0.05	0.11	0.10	0.10	0.13	0.22	0.13
Test Pressure (+67.50 psf)									
Maximum Deflection	0.39	3.20	0.28	0.39	0.37	0.38	0.59	0.83	0.51
Permanent Set	0.20	0.51	0.12	0.22	0.17	0.24	0.09	0.12	0.11
Test Pressure (-67.50 psf)									
Maximum Deflection	0.98	3.72	0.64	0.76	0.61	0.50	0.70	0.68	0.63
Permanent Set	0.39	0.64	0.07	0.34	0.26	0.23	0.05	0.10	0.16

**Note:** See Architectural Testing Sketch #1 for indicator locations.

**Test Results:** (Continued)

**Protocol ASTM E330-02, Static Air Pressure Tests**

**Test Unit #4** (Surface Mount)

**Design Pressure:**  $\pm 45.0$  psf

Title of Test	Results								
	Indicator Readings (inch)								
Structural Loads	#1	#2	#3	#4	#5	#6	#7	#8	#9
50% of Test Pressure (+33.75 psf)									
Maximum Deflection	0.10	1.90	0.15	0.10	0.14	0.13	0.23	0.30	0.17
Permanent Set	0.02	0.16	0.03	0.02	0.02	0.02	0.03	0.04	0.03
Design Pressure (+45.00 psf)									
Maximum Deflection	0.13	2.35	0.20	0.11	0.18	0.15	0.26	0.36	0.20
Permanent Set	0.02	0.19	0.03	0.02	0.02	0.02	0.05	0.05	0.05
50% of Test Pressure (-33.75 psf)									
Maximum Deflection	0.48	2.51	0.38	0.43	0.38	0.28	0.36	0.47	0.38
Permanent Set	0.29	0.46	0.04	0.31	0.04	0.18	0.06	0.07	0.06
Design Pressure (-45.00 psf)									
Maximum Deflection	0.56	3.01	0.54	0.53	0.46	0.37	0.45	0.59	0.49
Permanent Set	0.38	0.54	0.07	0.39	0.31	0.25	0.09	0.10	0.08
Test Pressure (+67.50 psf)									
Maximum Deflection	0.53	3.65	0.32	0.54	0.49	0.42	0.36	0.52	0.32
Permanent Set	0.35	0.54	0.08	0.37	0.31	0.24	0.09	0.10	0.08
Test Pressure (-67.50 psf)									
Maximum Deflection	0.82	4.08	0.82	0.73	0.62	0.51	0.70	0.90	0.79
Permanent Set	0.51	0.62	0.11	0.51	0.43	0.37	0.19	0.21	0.19

**Note:** See Architectural Testing Sketch #1 for indicator locations.

**Test Results:** (Continued)

**ASTM E 1886, *Large Missile Impact***

**Conditioning Temperature:** 22°C (72°F)

**Missile Weight:** 4196 g (9.25 lbs)

**Missile Length:** 2.3 m (7' 8-1/2")

**Muzzle Distance from Test Specimen:** 5.2 m (17 ft.)

**Test Unit #1** (Flush Mount)

**Impact #1:** Missile Velocity: 15.4 m/s (50.6 fps); orientation within  $\pm 5^\circ$  of vertical

**Impact Area:** Center of right panel

**Observations:** Missile hit target area, no penetration.

**Deflection:** 5.6 mm (0.22")

**Results:** Pass

**Impact #2:** Missile Velocity: 15.2 m/s (50.0 fps); orientation within  $\pm 5^\circ$  of vertical

**Impact Area:** Upper right corner of right panel

**Observations:** Missile hit target area, resulting in minor splitting of the plywood, no penetration.

**Deflection:** 3.3 mm (0.13")

**Results:** Pass

**Impact #3:** Missile Velocity: 15.4 m/s (50.6 fps); orientation within  $\pm 5^\circ$  of vertical

**Impact Area:** Midspan of vertical joint.

**Observations:** Missile hit target area, no penetration.

**Deflection:** 5.1 mm (0.20")

**Results:** Pass

*Note: See Architectural Testing Sketch #2 for impact locations.*

**Test Results:** (Continued)

**ASTM E 1886, *Large Missile Impact***

**Conditioning Temperature:** 22°C (72°F)

**Missile Weight:** 4196 g (9.25 lbs)

**Missile Length:** 2.3 m (7' 8-1/2")

**Muzzle Distance from Test Specimen:** 5.2 m (17 ft.)

**Test Unit #2 (Flush Mount)**

**Impact #1:** Missile Velocity: 15.2 m/s (49.9 fps); orientation within  $\pm 5^\circ$  of vertical

**Impact Area:** Center of right panel

**Observations:** Missile hit target area, no penetration.

**Deflection:** 31.8 mm (1.25 ")

**Results:** Pass

**Impact #2:** Missile Velocity: 15.3 m/s (50.3 fps); orientation within  $\pm 5^\circ$  of vertical

**Impact Area:** Lower left corner of right panel

**Observations:** Missile hit target area, no penetration.

**Deflection:** 10.7 mm (0.42")

**Results:** Pass

**Impact #3:** Missile Velocity: 15.4 m/s (50.4 fps); orientation within  $\pm 5^\circ$  of vertical

**Impact Area:** Midspan of vertical joint.

**Observations:** Missile hit target area, cracked the plywood strip, joining the panels, no penetration.

**Deflection:** 10.2 mm (0.40")

**Results:** Pass

*Note: See Architectural Testing Sketch #3 for impact locations.*



**Test Results:** (Continued)

**ASTM E 1886, *Large Missile Impact***

**Conditioning Temperature:** 22°C (72°F)

**Missile Weight:** 4196 g (9.25 lbs)

**Missile Length:** 2.3 m (7' 8-1/2")

**Muzzle Distance from Test Specimen:** 5.2 m (17 ft.)

**Test Unit #3** (Flush Mount)

**Impact #1:** Missile Velocity: 15.2 m/s (49.9 fps); orientation within  $\pm 5^\circ$  of vertical

**Impact Area:** Center of right panel

**Observations:** Missile hit target area, resulting in full penetration of missile, 3" sphere cannot freely pass through penetration.

**Deflection:** N/A (transducer released upon impact)

**Results:** Pass

**Impact #2:** Missile Velocity: 15.2 m/s (49.9 fps); orientation within  $\pm 5^\circ$  of vertical

**Impact Area:** Upper right corner of right panel

**Observations:** Missile hit target area, resulting in full penetration of missile. 3" sphere cannot freely pass through penetration.

**Deflection:** N/A (transducer released upon impact)

**Results:** Pass

**Impact #3:** Missile Velocity: 15.4 m/s (50.4 fps); orientation within  $\pm 5^\circ$  of vertical

**Impact Area:** Midspan of vertical joint.

**Observations:** Missile hit target area, cracked the plywood strip, joining the panels, no penetration.

**Deflection:** 10.2 mm (0.40")

**Results:** Pass

*Note: See Architectural Testing Sketch #4 for impact locations.*

**Test Results:** (Continued)

**ASTM E 1886, *Large Missile Impact***

**Conditioning Temperature:** 22°C (72°F)

**Missile Weight:** 4196 g (9.25 lbs)

**Missile Length:** 2.3 m (7' 8-1/2")

**Muzzle Distance from Test Specimen:** 5.2 m (17 ft.)

**Test Unit #4** (Surface Mount)

**Impact #1:** Missile Velocity: 15.3 m/s (50.1 fps); orientation within  $\pm 5^\circ$  of vertical

**Impact Area:** Center of right panel

**Observations:** Missile hit target area, no penetration.

**Deflection:** 4.1 mm (0.16")

**Results:** Pass

**Impact #2:** Missile Velocity: 15.3 m/s (50.1 fps); orientation within  $\pm 5^\circ$  of vertical

**Impact Area:** Lower left corner of right panel

**Observations:** Missile hit target area, resulting in a full penetration of the missile, 3" sphere cannot freely pass through the penetration.

**Deflection:** N/A

**Results:** Pass

**Impact #3:** Missile Velocity: 15.3 m/s (50.3 fps); orientation within  $\pm 5^\circ$  of vertical

**Impact Area:** Midspan of vertical joint.

**Observations:** Missile hit target area, no penetration.

**Deflection:** 12.2 mm (0.48")

**Results:** Pass

*Note: See Architectural Testing Sketch #5 for impact locations.*

**Test Results:** (Continued)

**ASTM E 1886, Air Pressure Cycling**

**Test Unit #1** (Flush Mount)

**Design Pressure:** ±2155 Pa (±45.0 psf)

**POSITIVE PRESSURE**

Pressure Range Pa (psf)	Number of Cycles	Average Cycle Time (seconds)	Maximum Deflection at Indicator mm (inch)								
			#1	#2	#3	#4	#5	#6	#7	#8	#9
430 to 1077 (9.0 to 22.5)	3500	3.09	5.3 (0.21)	46.5 (1.83)	5.6 (0.22)	5.3 (0.21)	4.3 (0.17)	4.3 (0.17)	10.9 (0.43)	14.0 (0.55)	11.2 (0.44)
0 to 1293 (0 to 27.0)	300	3.64	5.3 (0.21)	51.0 (2.01)	5.6 (0.22)	5.3 (0.21)	4.3 (0.17)	4.8 (0.19)	11.4 (0.45)	14.7 (0.58)	11.4 (0.45)
1077 to 1724 (22.5 to 36.0)	600	2.97	5.3 (0.21)	63.2 (2.49)	5.6 (0.25)	6.4 (0.25)	4.3 (0.17)	6.9 (0.27)	13.2 (0.52)	17.0 (0.67)	13.5 (0.53)
646 to 2155 (13.5 to 45.0)	100	3.97	5.3 (0.21)	71.1 (2.80)	7.4 (0.29)	6.9 (0.27)	4.3 (0.17)	6.9 (0.27)	14.0 (0.55)	18.3 (0.72)	14.2 (0.56)
			<b>Permanent Set</b>								
			0.3 (0.01)	7.1 (0.28)	2.0 (0.08)	0.3 (0.01)	0.3 (0.01)	1.3 (0.05)	2.5 (0.10)	2.3 (0.09)	4.6 (0.18)

**NEGATIVE PRESSURE**

Pressure Range Pa (psf)	Number of Cycles	Average Cycle Time (seconds)	Maximum Deflection at Indicator mm (inch)								
			#1	#2	#3	#4	#5	#6	#7	#8	#9
646 to 2155 (13.5 to 45.0)	3500	4.24	13.7 (0.54)	73.2 (2.88)	18.3 (0.72)	10.4 (0.41)	23.6 (0.93)	9.9 (0.39)	17.3 (0.68)	18.0 (0.71)	13.7 (0.54)
1077 to 1724 (22.5 to 36.0)	300	3.12	10.9 (0.43)	63.8 (2.51)	17.5 (0.69)	9.9 (0.39)	22.9 (0.90)	9.4 (0.37)	15.5 (0.61)	17.0 (0.70)	13.0 (0.51)
0 to 1293 (0 to 27.0)	600	4.56	10.7 (0.42)	52.8 (2.08)	12.4 (0.49)	7.1 (0.28)	5.8 (0.23)	5.3 (0.21)	10.9 (0.43)	11.7 (0.46)	5.8 (0.23)
430 to 1077 (9.0 to 22.5)	100	2.86	10.2 (0.40)	48.5 (1.91)	13.2 (0.52)	8.9 (0.35)	4.8 (0.19)	5.6 (0.22)	10.7 (0.42)	10.9 (0.43)	5.1 (0.20)
			<b>Permanent Set</b>								
			0.5 (0.02)	5.3 (0.21)	4.8 (0.19)	3.6 (0.14)	4.6 (0.18)	1.8 (0.07)	1.5 (0.06)	1.0 (0.04)	0.3 (0.01)

**Observations:** No additional damage was observed.

**Result:** Pass

**Note:** See Architectural Testing Sketch #1 for indicator locations.

Test Results: (Continued)

ASTM E 1886, Air Pressure Cycling

Test Unit #2 (Flush Mount)

Design Pressure: ±2155 Pa (±45.0 psf)

**POSITIVE PRESSURE**

Pressure Range Pa (psf)	Number of Cycles	Average Cycle Time (seconds)	Maximum Deflection at Indicator mm (inch)								
			#1	#2	#3	#4	#5	#6	#7	#8	#9
430 to 1077 (9.0 to 22.5)	3500	2.82	7.4 (0.29)	47.8 (1.88)	10.9 (0.43)	3.6 (0.14)	6.6 (0.26)	6.9 (0.27)	13.7 (0.54)	17.0 (0.67)	16.3 (0.64)
0 to 1293 (0 to 27.0)	300	4.79	7.6 (0.30)	53.1 (2.09)	11.4 (0.45)	3.6 (0.14)	6.6 (0.26)	7.1 (0.28)	14.0 (0.55)	17.8 (0.70)	17.0 (0.67)
1077 to 1724 (22.5 to 36.0)	600	2.95	9.9 (0.39)	67.1 (2.64)	13.0 (0.51)	4.6 (0.18)	8.1 (0.32)	8.6 (0.34)	16.3 (0.64)	20.6 (0.81)	19.3 (0.76)
646 to 2155 (13.5 to 45.0)	100	5.08	9.9 (0.39)	73.4 (2.89)	13.7 (0.54)	4.6 (0.18)	8.4 (0.33)	8.6 (0.34)	16.8 (0.66)	21.3 (0.84)	20.1 (0.79)
			<b>Permanent Set</b>								
			2.5 (0.10)	10.9 (0.43)	6.6 (0.26)	1.8 (0.07)	3.1 (0.15)	4.1 (0.16)	8.9 (0.35)	11.2 (0.44)	10.2 (0.40)

**NEGATIVE PRESSURE**

Pressure Range Pa (psf)	Number of Cycles	Average Cycle Time (seconds)	Maximum Deflection at Indicator mm (inch)								
			#1	#2	#3	#4	#5	#6	#7	#8	#9
646 to 2155 (13.5 to 45.0)	3500	4.34	39.4 (1.55)	96.3 (3.79)	31.2 (1.23)	15.2 (0.60)	17.8 (0.70)	17.3 (0.68)	21.8 (0.86)	26.7 (1.05)	24.9 (0.98)
1077 to 1724 (22.5 to 36.0)	300	2.68	39.4 (1.55)	90.2 (3.55)	30.7 (1.21)	15.2 (0.60)	17.5 (0.69)	17.3 (0.68)	21.8 (0.86)	26.4 (1.04)	24.4 (0.96)
0 to 1293 (0 to 27.0)	600	5.78	35.8 (1.41)	75.9 (2.99)	27.7 (1.09)	14.7 (0.58)	17.0 (0.67)	18.5 (0.73)	18.5 (0.73)	22.1 (0.87)	20.8 (0.82)
430 to 1077 (9.0 to 22.5)	100	2.81	34.3 (1.35)	71.4 (2.81)	26.7 (1.05)	14.7 (0.58)	17.0 (0.67)	17.3 (0.68)	17.8 (0.70)	21.1 (0.83)	19.8 (0.78)
			<b>Permanent Set</b>								
			25.4 (1.00)	28.4 (1.12)	15.2 (0.60)	13.0 (0.51)	14.7 (0.58)	15.2 (0.60)	12.4 (0.49)	14.7 (0.58)	14.8 (0.56)

**Observations:** No additional damage was observed.

**Result:** Pass

**Note:** See Architectural Testing Sketch #1 for indicator locations.

Test Results: (Continued)

ASTM E 1886, Air Pressure Cycling

Test Unit #3 (Flush Mount)

Design Pressure:  $\pm 2155$  Pa ( $\pm 45.0$  psf)

**POSITIVE PRESSURE**

Pressure Range Pa (psf)	Number of Cycles	Average Cycle Time (seconds)	Maximum Deflection at Indicator mm (inch)								
			#1	#2	#3	#4	#5	#6	#7	#8	#9
430 to 1077 (9.0 to 22.5)	3500	2.58	10.67 (0.42)	44.45 (1.75)	5.33 (0.21)	8.13 (0.32)	9.14 (0.36)	9.14 (0.36)	11.94 (0.47)	12.95 (0.51)	11.68 (0.46)
0 to 1293 (0 to 27.0)	300	4.28	11.18 (0.44)	45.97 (1.81)	5.84 (0.23)	8.38 (0.33)	9.40 (0.37)	9.40 (0.37)	12.19 (0.48)	13.21 (0.52)	12.19 (0.48)
1077 to 1724 (22.5 to 36.0)	600	3.50	13.21 (0.52)	61.47 (2.42)	7.87 (0.31)	10.67 (0.42)	11.43 (0.45)	11.43 (0.45)	14.73 (0.58)	16.00 (0.63)	14.22 (0.56)
646 to 2155 (13.5 to 45.0)	100	3.91	13.72 (0.54)	66.80 (2.63)	8.64 (0.34)	11.18 (0.44)	12.19 (0.48)	11.94 (0.47)	15.75 (0.62)	17.02 (0.67)	14.99 (0.59)
			<b>Permanent Set</b>								
			6.86 (0.27)	10.67 (0.42)	3.56 (0.14)	5.33 (0.21)	5.84 (0.23)	4.83 (0.19)	6.35 (0.25)	7.37 (0.29)	5.84 (0.23)

**NEGATIVE PRESSURE**

Pressure Range Pa (psf)	Number of Cycles	Average Cycle Time (seconds)	Maximum Deflection at Indicator mm (inch)								
			#1	#2	#3	#4	#5	#6	#7	#8	#9
646 to 2155 (13.5 to 45.0)	3500	3.92	22.86 (0.90)	71.37 (2.81)	16.51 (0.65)	15.24 (0.60)	13.21 (0.52)	10.92 (0.43)	17.78 (0.70)	20.83 (0.82)	18.29 (0.72)
1077 to 1724 (22.5 to 36.0)	300	2.49	22.10 (0.87)	65.53 (2.58)	15.24 (0.60)	14.48 (0.57)	12.45 (0.49)	10.16 (0.40)	16.26 (0.64)	19.30 (0.76)	16.51 (0.65)
0 to 1293 (0 to 27.0)	600	4.70	21.34 (0.84)	59.18 (2.33)	13.72 (0.54)	14.48 (0.57)	12.45 (0.49)	9.91 (0.39)	14.99 (0.59)	17.53 (0.69)	14.99 (0.59)
430 to 1077 (9.0 to 22.5)	100	2.89	20.07 (0.79)	54.36 (2.14)	12.95 (0.51)	14.22 (0.56)	11.94 (0.47)	9.91 (0.39)	14.48 (0.57)	17.02 (0.67)	14.48 (0.57)
			<b>Permanent Set</b>								
			6.60 (0.26)	17.78 (0.70)	4.32 (0.17)	9.91 (0.39)	9.65 (0.38)	4.57 (0.18)	8.38 (0.33)	7.87 (0.31)	8.64 (0.34)

**Observations:** No additional damage was observed.

**Result:** Pass

**Note:** See Architectural Testing Sketch #1 for indicator locations.

Test Results: (Continued)

ASTM E 1886, Air Pressure Cycling

Test Unit #3 (Flush Mount)

Design Pressure: ±2155 Pa (±45.0 psf)

**POSITIVE PRESSURE**

Pressure Range Pa (psf)	Number of Cycles	Average Cycle Time (seconds)	Maximum Deflection at Indicator mm (inch)								
			#1	#2	#3	#4	#5	#6	#7	#8	#9
430 to 1077 (9.0 to 22.5)	3500	2.84	7.6 (0.30)	58.7 (2.31)	4.6 (0.18)	3.8 (0.15)	4.3 (0.17)	3.8 (0.15)	2.5 (0.10)	1.3 (0.05)	1.5 (0.06)
0 to 1293 (0 to 27.0)	300	4.79	7.9 (0.31)	66.0 (2.60)	4.6 (0.18)	3.8 (0.15)	4.3 (0.17)	4.1 (0.16)	2.8 (0.11)	1.3 (0.05)	2.0 (0.08)
1077 to 1724 (22.5 to 36.0)	600	2.79	8.4 (0.33)	72.6 (2.86)	5.1 (0.20)	4.1 (0.16)	5.1 (0.20)	4.6 (0.18)	3.0 (0.12)	1.5 (0.06)	2.3 (0.09)
646 to 2155 (13.5 to 45.0)	100	4.62	8.9 (0.35)	87.1 (3.43)	6.4 (0.25)	4.6 (0.18)	5.3 (0.21)	4.6 (0.18)	3.6 (0.14)	1.8 (0.07)	2.3 (0.09)
			<b>Permanent Set</b>								
			1.0 (0.04)	3.8 (0.15)	1.5 (0.06)	3.3 (0.13)	1.8 (0.07)	3.0 (0.12)	1.5 (0.06)	1.3 (0.05)	1.0 (0.04)

**NEGATIVE PRESSURE**

Pressure Range Pa (psf)	Number of Cycles	Average Cycle Time (seconds)	Maximum Deflection at Indicator mm (inch)								
			#1	#2	#3	#4	#5	#6	#7	#8	#9
646 to 2155 (13.5 to 45.0)	3500	4.39	15.2 (0.60)	79.0 (3.11)	16.0 (0.63)	11.7 (0.44)	12.2 (0.48)	5.8 (0.23)	18.0 (0.71)	19.8 (0.78)	19.1 (0.75)
1077 to 1724 (22.5 to 36.0)	300	2.44	19.6 (0.77)	76.7 (3.02)	16.8 (0.66)	18.5 (0.73)	17.5 (0.69)	17.8 (0.70)	18.0 (0.71)	19.8 (0.78)	19.1 (0.75)
0 to 1293 (0 to 27.0)	600	4.63	22.3 (0.88)	70.4 (2.77)	15.7 (0.62)	19.8 (0.78)	17.8 (0.70)	17.5 (0.69)	16.3 (0.64)	17.8 (0.70)	16.8 (0.66)
430 to 1077 (9.0 to 22.5)	100	2.39	22.3 (0.88)	65.8 (2.59)	16.5 (0.65)	36.1 (1.42)	17.3 (0.68)	16.5 (0.65)	15.7 (0.62)	17.3 (0.68)	16.0 (0.63)
			<b>Permanent Set</b>								
			21.3 (0.84)	4.8 (0.19)	2.5 (0.10)	23.9 (0.94)	6.1 (0.24)	5.3 (0.21)	3.0 (0.12)	2.8 (0.11)	2.8 (0.11)

**Observations:** No additional damage or deglazing was observed.

**Result:** Pass

**Note:** See Architectural Testing Sketch #1 for indicator locations.

**General Note:** Upon completion of testing, the specimens met the requirements of Section 7 of ASTM E 1996.

**Test Equipment:** (See Appendix A)

**Canon:** Constructed from steel piping utilizing compressed air to propel the missile

**Missile:** 2x4 Southern Pine

**Timing Device:** Electronic Beam Type

**Cycling Mechanism:** Computer controlled centrifugal blower with electronic pressure measuring device

**Deflection Measuring Device:** Linear transducers

Tape and film were used to seal against air leakage during structural testing. In our opinion, the tape and film did not influence the results of the test.

**Drawing Reference:** The test specimen drawings have been reviewed by Architectural Testing and are representative of the test specimen reported herein.

**List of Official Observers:**

<u>Name</u>	<u>Company</u>
Chris Langer	Norse, Inc.
Alfred C. Langer	Norse, Inc.
Aaron M. Shultz	Architectural Testing, Inc.
Tim J. McGill	Architectural Testing, Inc.
Michael D. Stremmel, P.E.	Architectural Testing, Inc.
Eric M. Brennan	Architectural Testing, Inc.

Detailed drawings, data sheets, representative samples of test specimens, a copy of this report, or other pertinent project documentation will be retained by Architectural Testing, Inc. for a period of four years from the original test date. At the end of this retention period, such materials shall be discarded without notice and the service life of this report will expire.

Results obtained are tested values and were secured by using the designated test methods. This report does not constitute certification of this product nor an opinion or endorsement by this laboratory. It is the exclusive property of the client so named herein and relates only to the specimen(s) tested. This report may not be reproduced, except in full, without the written approval of Architectural Testing, Inc.

For ARCHITECTURAL TESTING, INC.

---

Eric M. Brennan  
Technician

---

Michael D. Stremmel, P.E.  
Senior Project Engineer

EMB:dem

Attachments (pages): This report is complete only when all attachments listed are included.

- Appendix-A: Test Equipment (1)
- Appendix-B: Sketches (5)
- Appendix-C: Photograph (1)
- Appendix-D: Drawings (7)



### Revision Log

<u>Rev. #</u>	<u>Date</u>	<u>Page(s)</u>	<u>Revision(s)</u>
0	09/11/09	N/A	Original report issue
1	09/21/09	Cover Page, Page 15, and Appendix D	Revised drawing packet to include missed drawings.


**Appendix A**  
**Test Equipment**

<b>Instrument</b>	<b>Manufacturer</b>	<b>Asset #</b>
20" Linear Transducer	Celesco	Y002774
20" Linear Transducer	Celesco	62186
20" Linear Transducer	Celesco	62183
20" Linear Transducer	Celesco	003624
20" Linear Transducer	Celesco	Y003027
20" Linear Transducer	Celesco	003439
20" Linear Transducer	Celesco	62184
40" Linear Transducer	Celesco	62261-1
40" Linear Transducer	Celesco	62261-2
Control Panel (Blower)	Architectural Testing, Inc.	3232
Control Panel (Blower)	Architectural Testing, Inc.	5406
Cannon	Architectural Testing, Inc.	005118

## **Appendix B**

### **Sketches**

REV	DATE	DESCRIPTION	BY

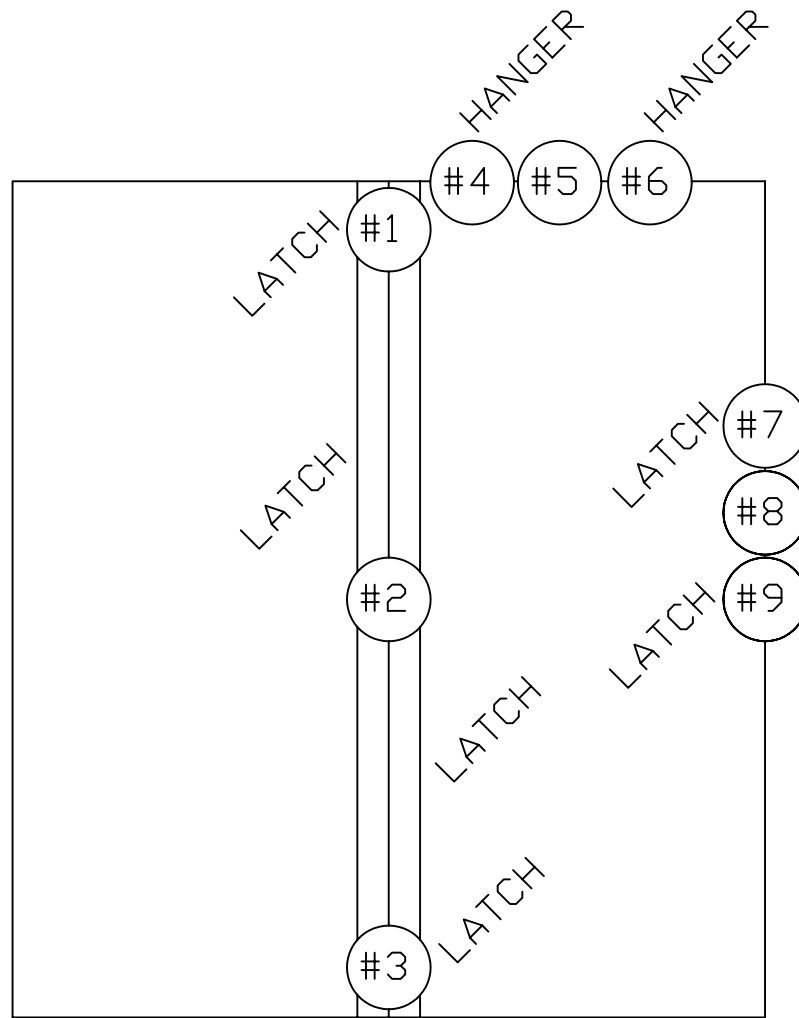

INDICATOR LOCATIONS

PROJECT NO.  
92518.01  
109-44

PROJECT NAME: Shutters- ASTM E1886/E1996  
CLIENT: Norse, Inc.



DRAWING


Sketch #1(Indicators)

DWG. BY:  
TJM  
DATE:  
09/10/09

SHEET  
1 OF  
1

REV	DATE	DESCRIPTION	BY


UNIT #1

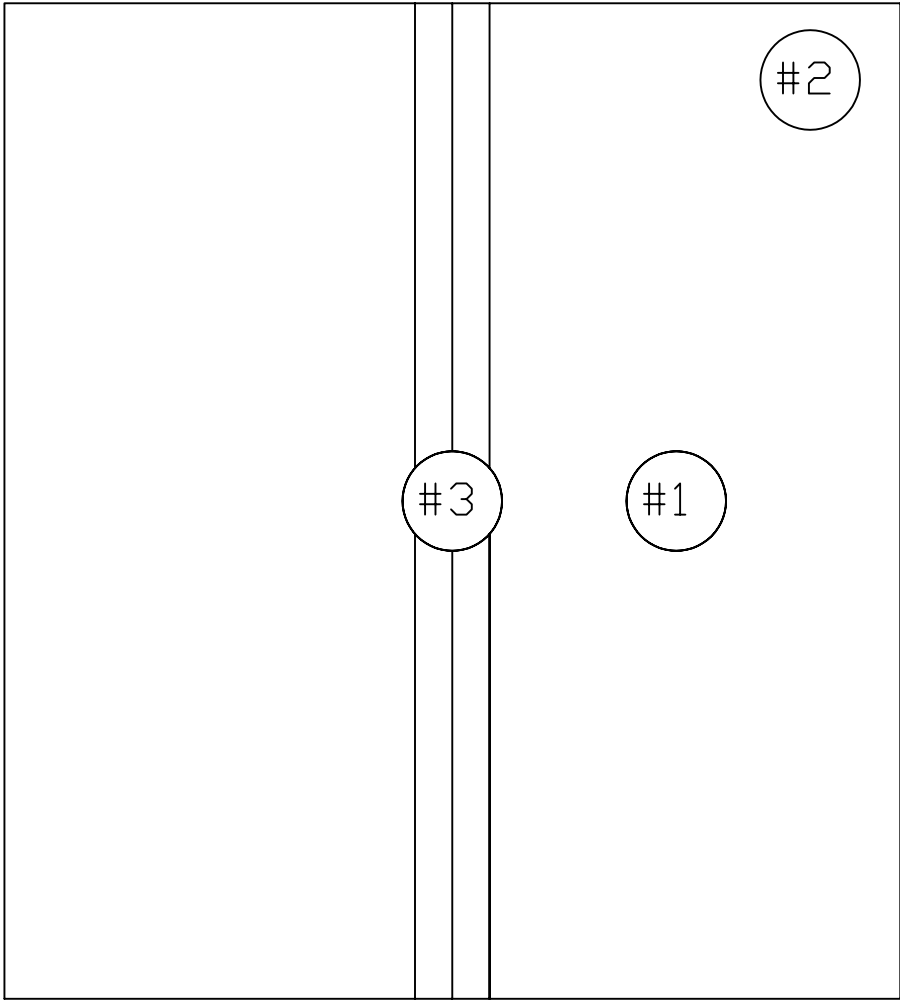

IMPACT LOCATIONS

REV	DATE	DESCRIPTION	BY

UNIT #2

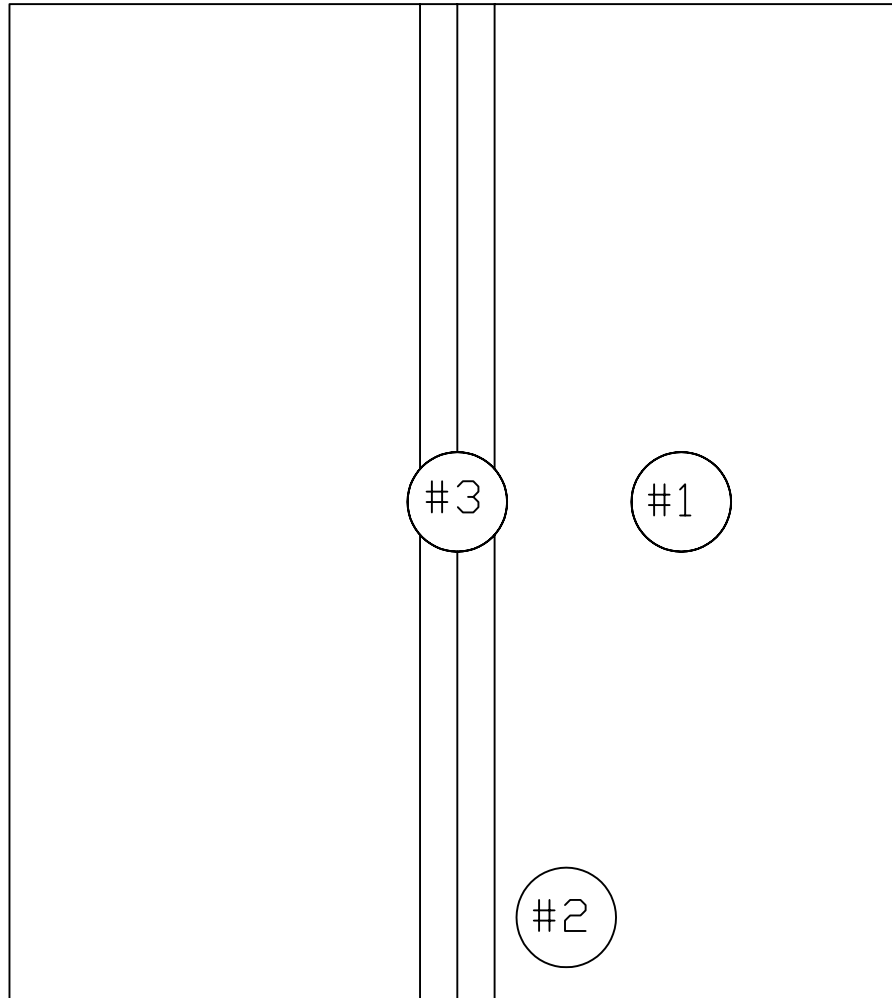

IMPACT LOCATIONS

PROJECT NO.  
92518.01  
109-44

PROJECT NAME: Shutters- ASTM E1886/E1996  
CLIENT: Norse, Inc.



DRAWING


Sketch #3 (Unit #2)

DWG. BY:  
TJM  
DATE:  
09/10/09

SHEET  
1 OF  
1

REV	DATE	DESCRIPTION	BY

UNIT #3

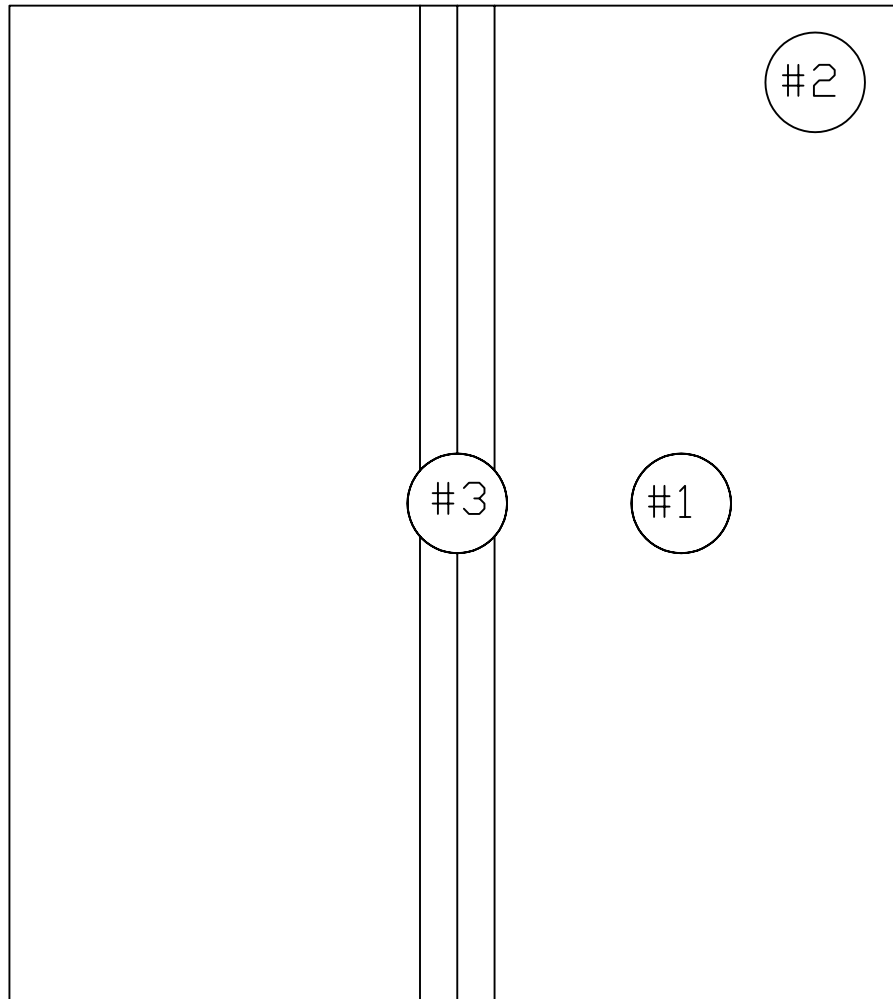

IMPACT LOCATIONS

PROJECT NO.  
92518.01  
109-44

PROJECT NAME: Shutters- ASTM E1886/E1996  
CLIENT: Norse, Inc.



DRAWING


Sketch #4 (Unit #3)

DWG. BY:  
TJM  
DATE:  
09/10/09

SHEET  
1 OF  
1

REV	DATE	DESCRIPTION	BY

UNIT #4

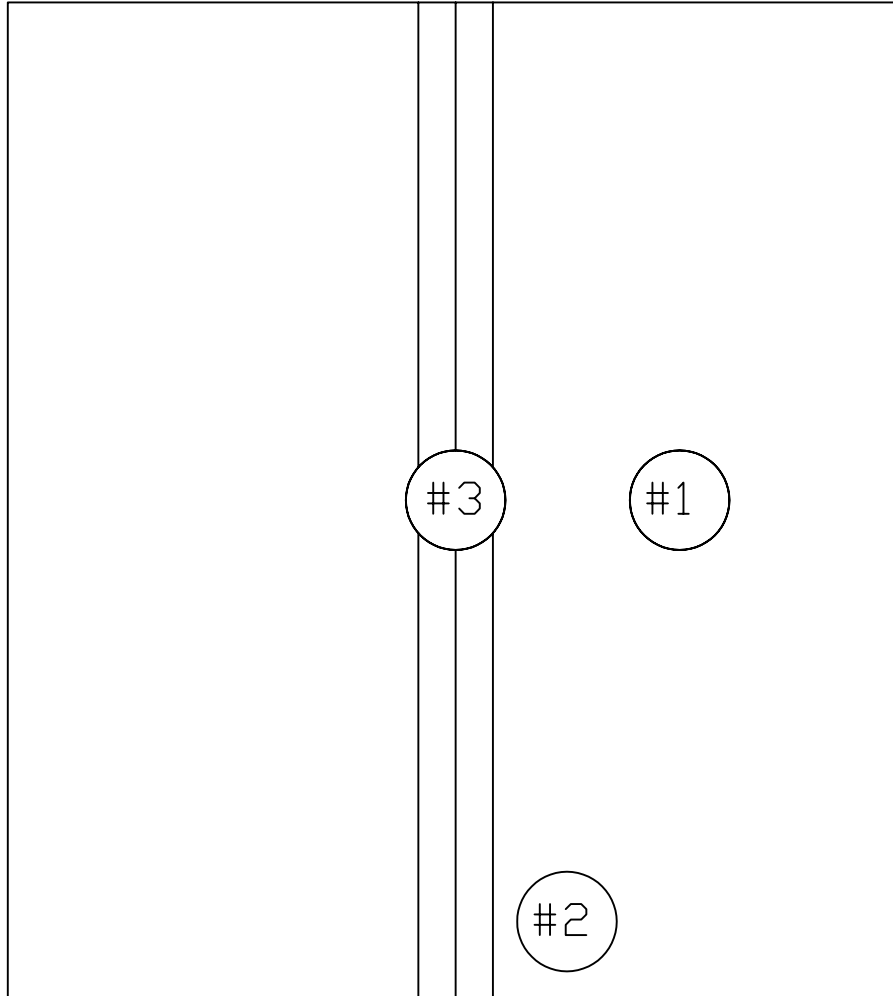

IMPACT LOCATIONS

PROJECT NO.  
92518.01  
109-44

PROJECT NAME: Shutters- ASTM E1886/E1996  
CLIENT: Norse, Inc.



DRAWING  
Sketch #5 (Unit #4)

DWG. BY:  
TJM  
DATE:  
09/10/09

SHEET  
1 OF  
1



**Appendix C**  
**Photograph**



**Product Overview**

## **Appendix D**

### **Drawings**

## NORSE LATCHING COMPONENTS, SHUTTER PLYWOOD, & HARDWARE USED FOR SURFACE MOUNTING TEST

ITEM	QUANTITY
#10 x 1 1/4" PHWS/BATTEN	20
*#10 x 3/4" PHWS	64
#10-32 x 1/4" PHMS W/NUTS & WASHERS	4
1/4" x 1 1/2" LAG. BOLTS W/ANCHORS	6
'TAPCON' SCREWS 3/4" x 1 3/4"	36
#10-32 x 1 1/4" FHMS (10 x 2) W/NUTS & WASHERS	20

### NORSE HARDWARE




HOOKS (HK/S2)	10
HANGERS (HNG/S2)	10
BIG 'T' RECEIVERS (BOTR-1)/BATTEN	12
TYPE 1R LATCH (RH-S1500-1R-750)	8
TYPE 1L LATCH (LH-S1500-1L-750)	4
BOTTOM STOP (BS1)	6
PLYWOOD SHUTTERS (5/8" x 37 1/2" X 81 1/2")	2
BATTEN PLYWOOD (5/8" x 6" x 81 1/2")	1
<u>*#10 x 3/4" PHWS:</u>	
LATCHES (12 x 4)	48
BOTTOM STOPS (6 x 2)	12
BIG 'T' AT BATTEN (2 x 2)	4
TOTAL	64

REF: DWG. B101,293B

**TEST CONDUCTED AT ARCHITECTURAL TESTING  
INC, YORK PA THE WEEK OF AUGUST 17, 2009.**

Architectural Testing

Architectural Testing  
Test sample complies with these details.  
Deviations are noted.  
Report# 92518.01-109-44  
Date 9/9/09 Tech Banner

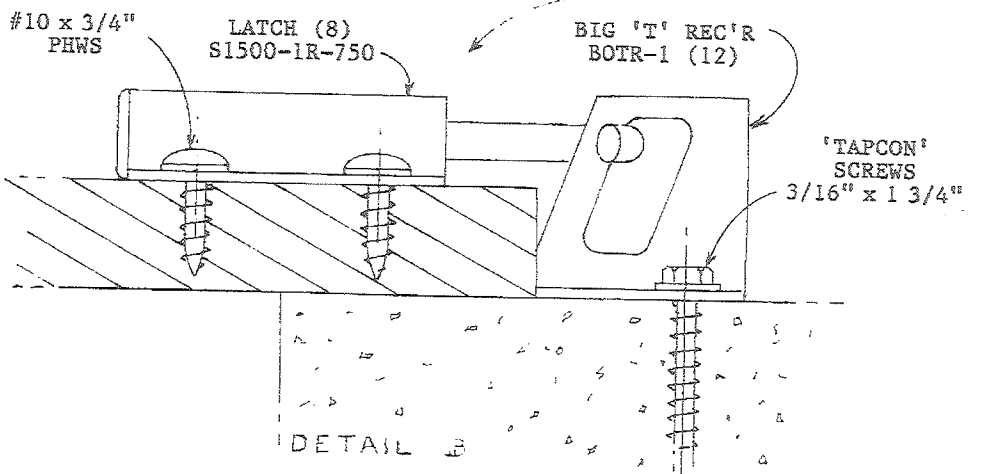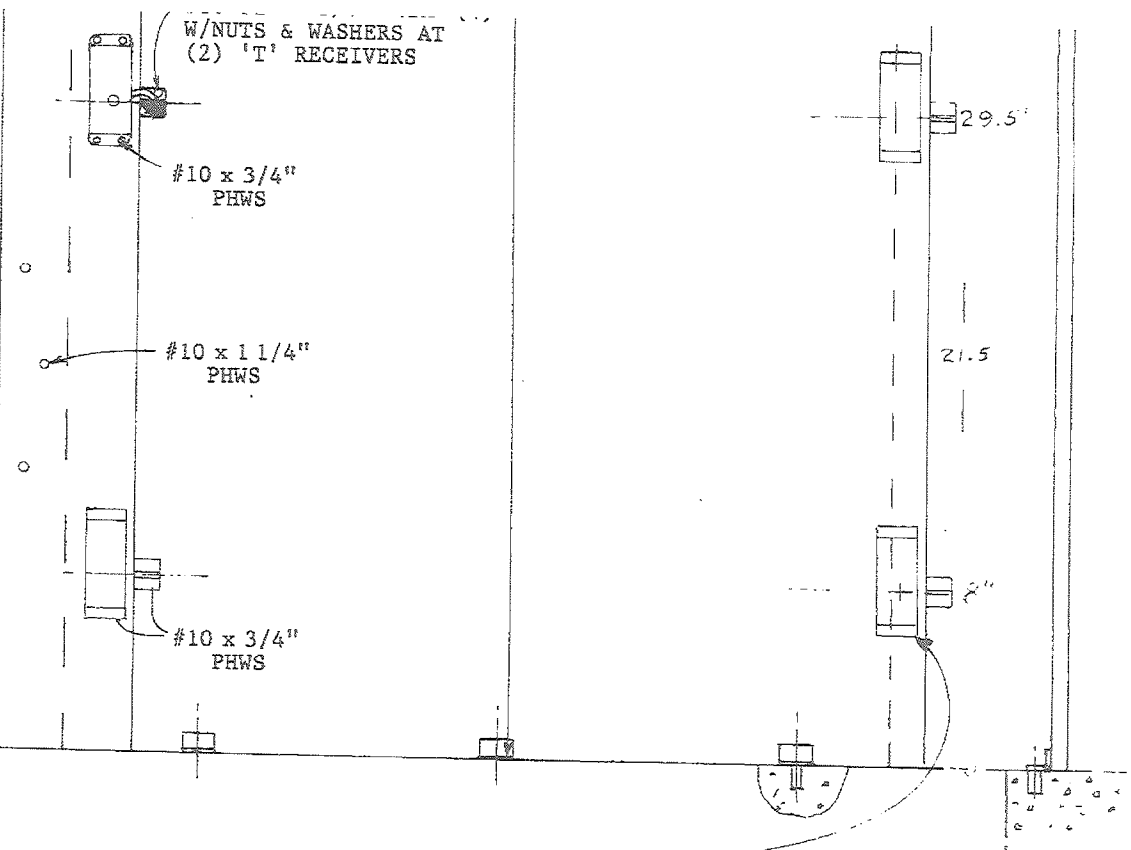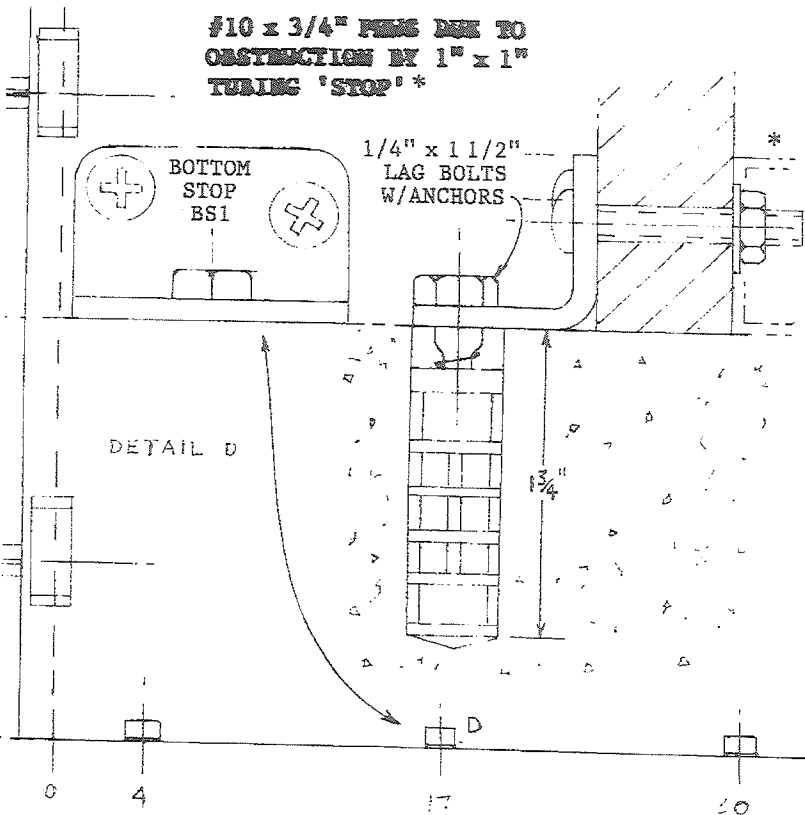



Architectural Testing

Test sample complies with these details. Deviations are noted.

Report: 92516-01-05-44  
 Date: 9/9/09  
 Tech: *Banner*

<b>NORSE</b> 1180	
72" x 80" TWO PANEL SURFACE MOUNTING HARDWARE CEMENT TEST BUCK	
SIZE <b>B</b>	CODE IDENT. NO. <b>B101, 293 B</b>
SCALE 1/8" = 1" 26 AUG 09 SHEET	

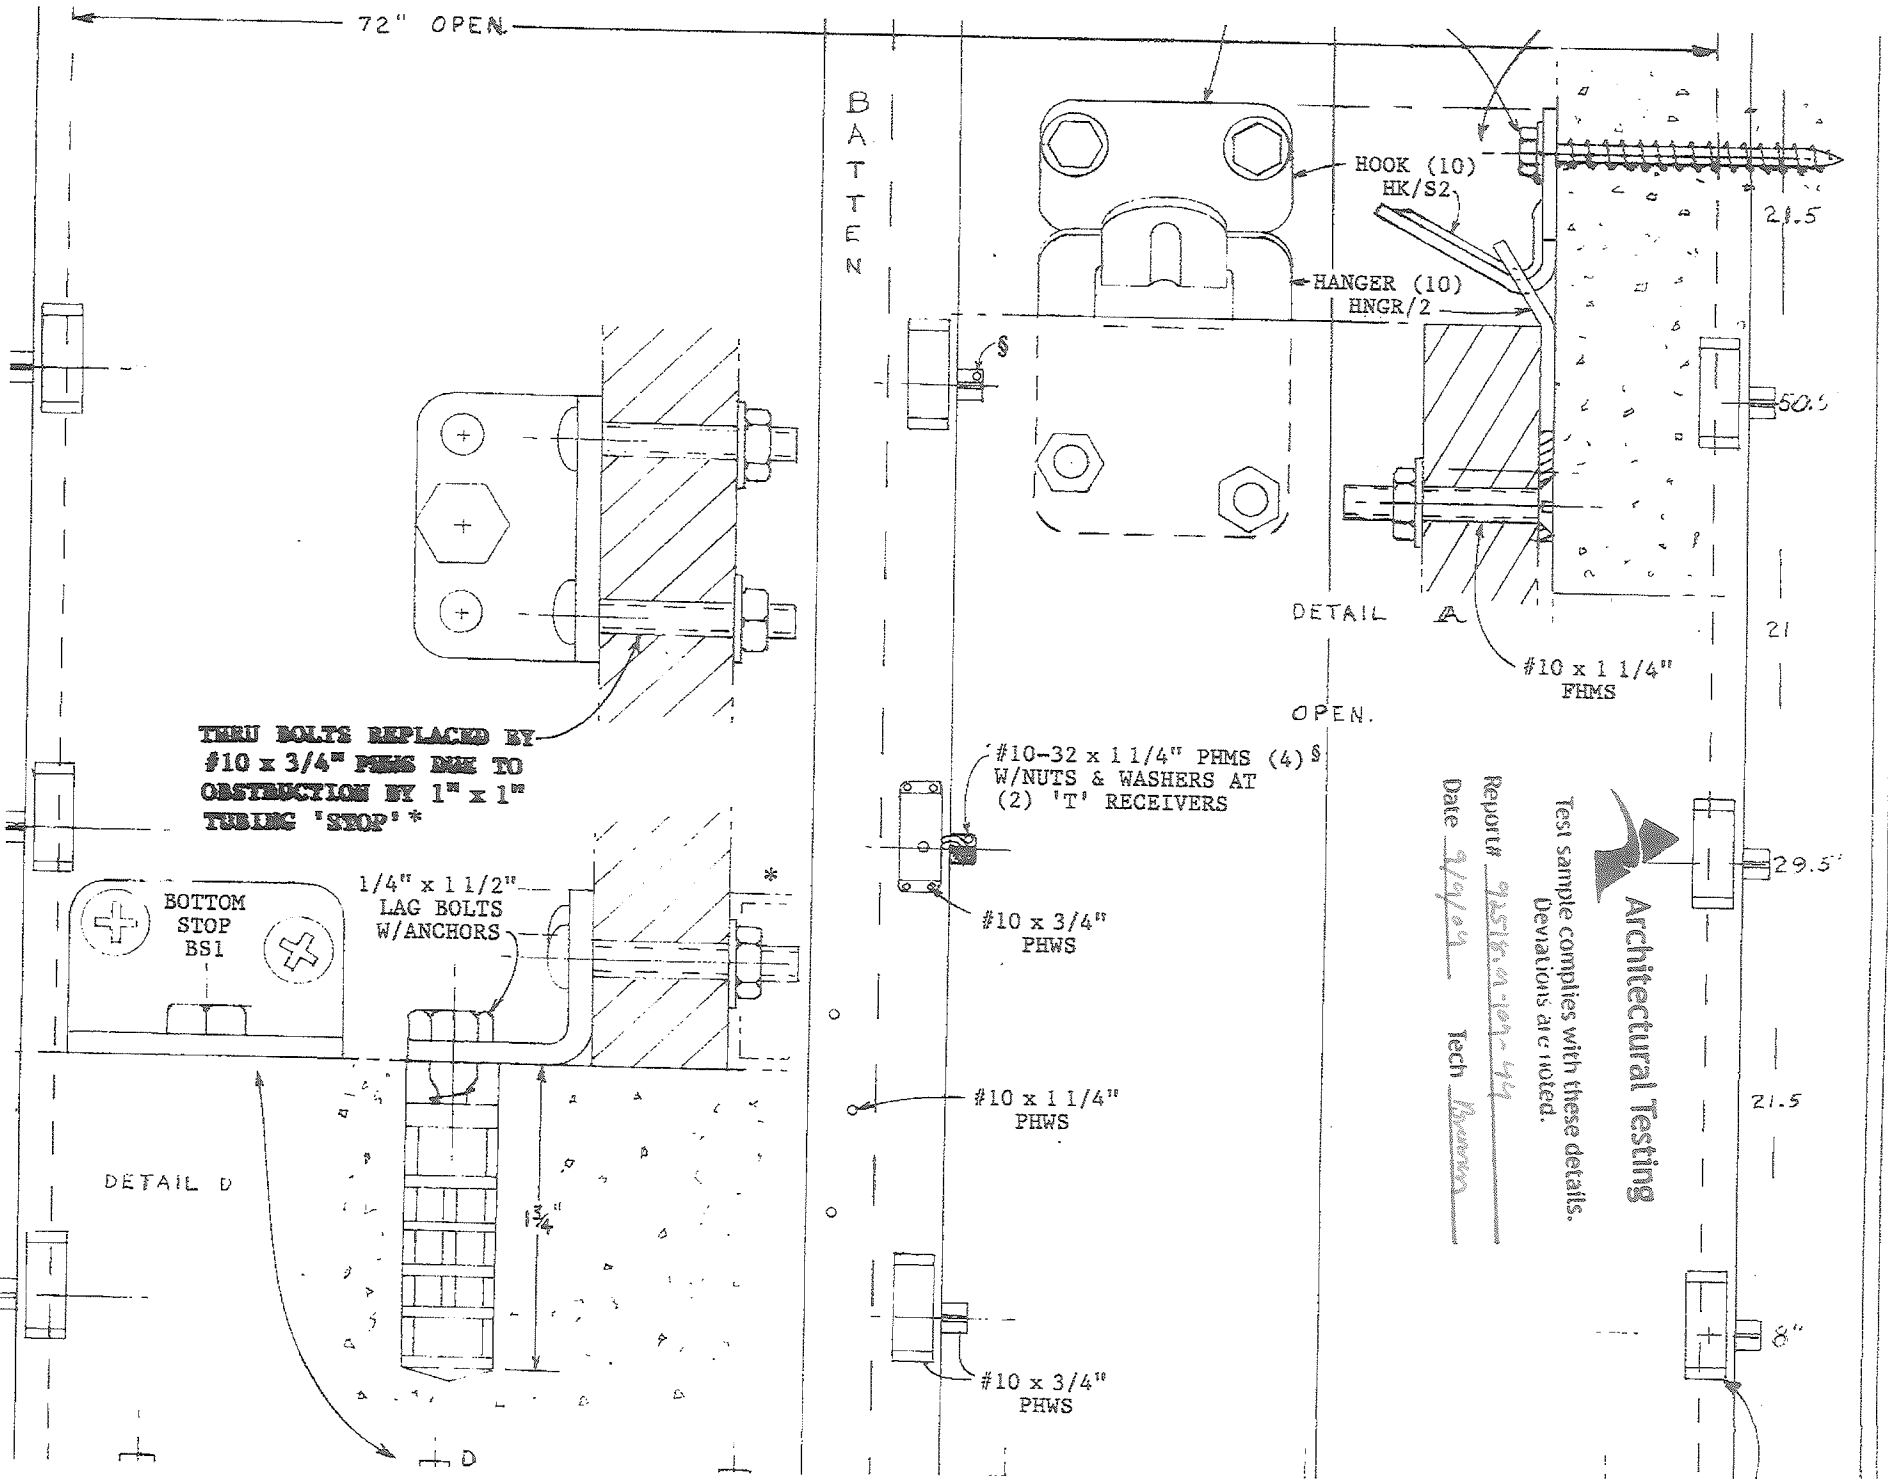

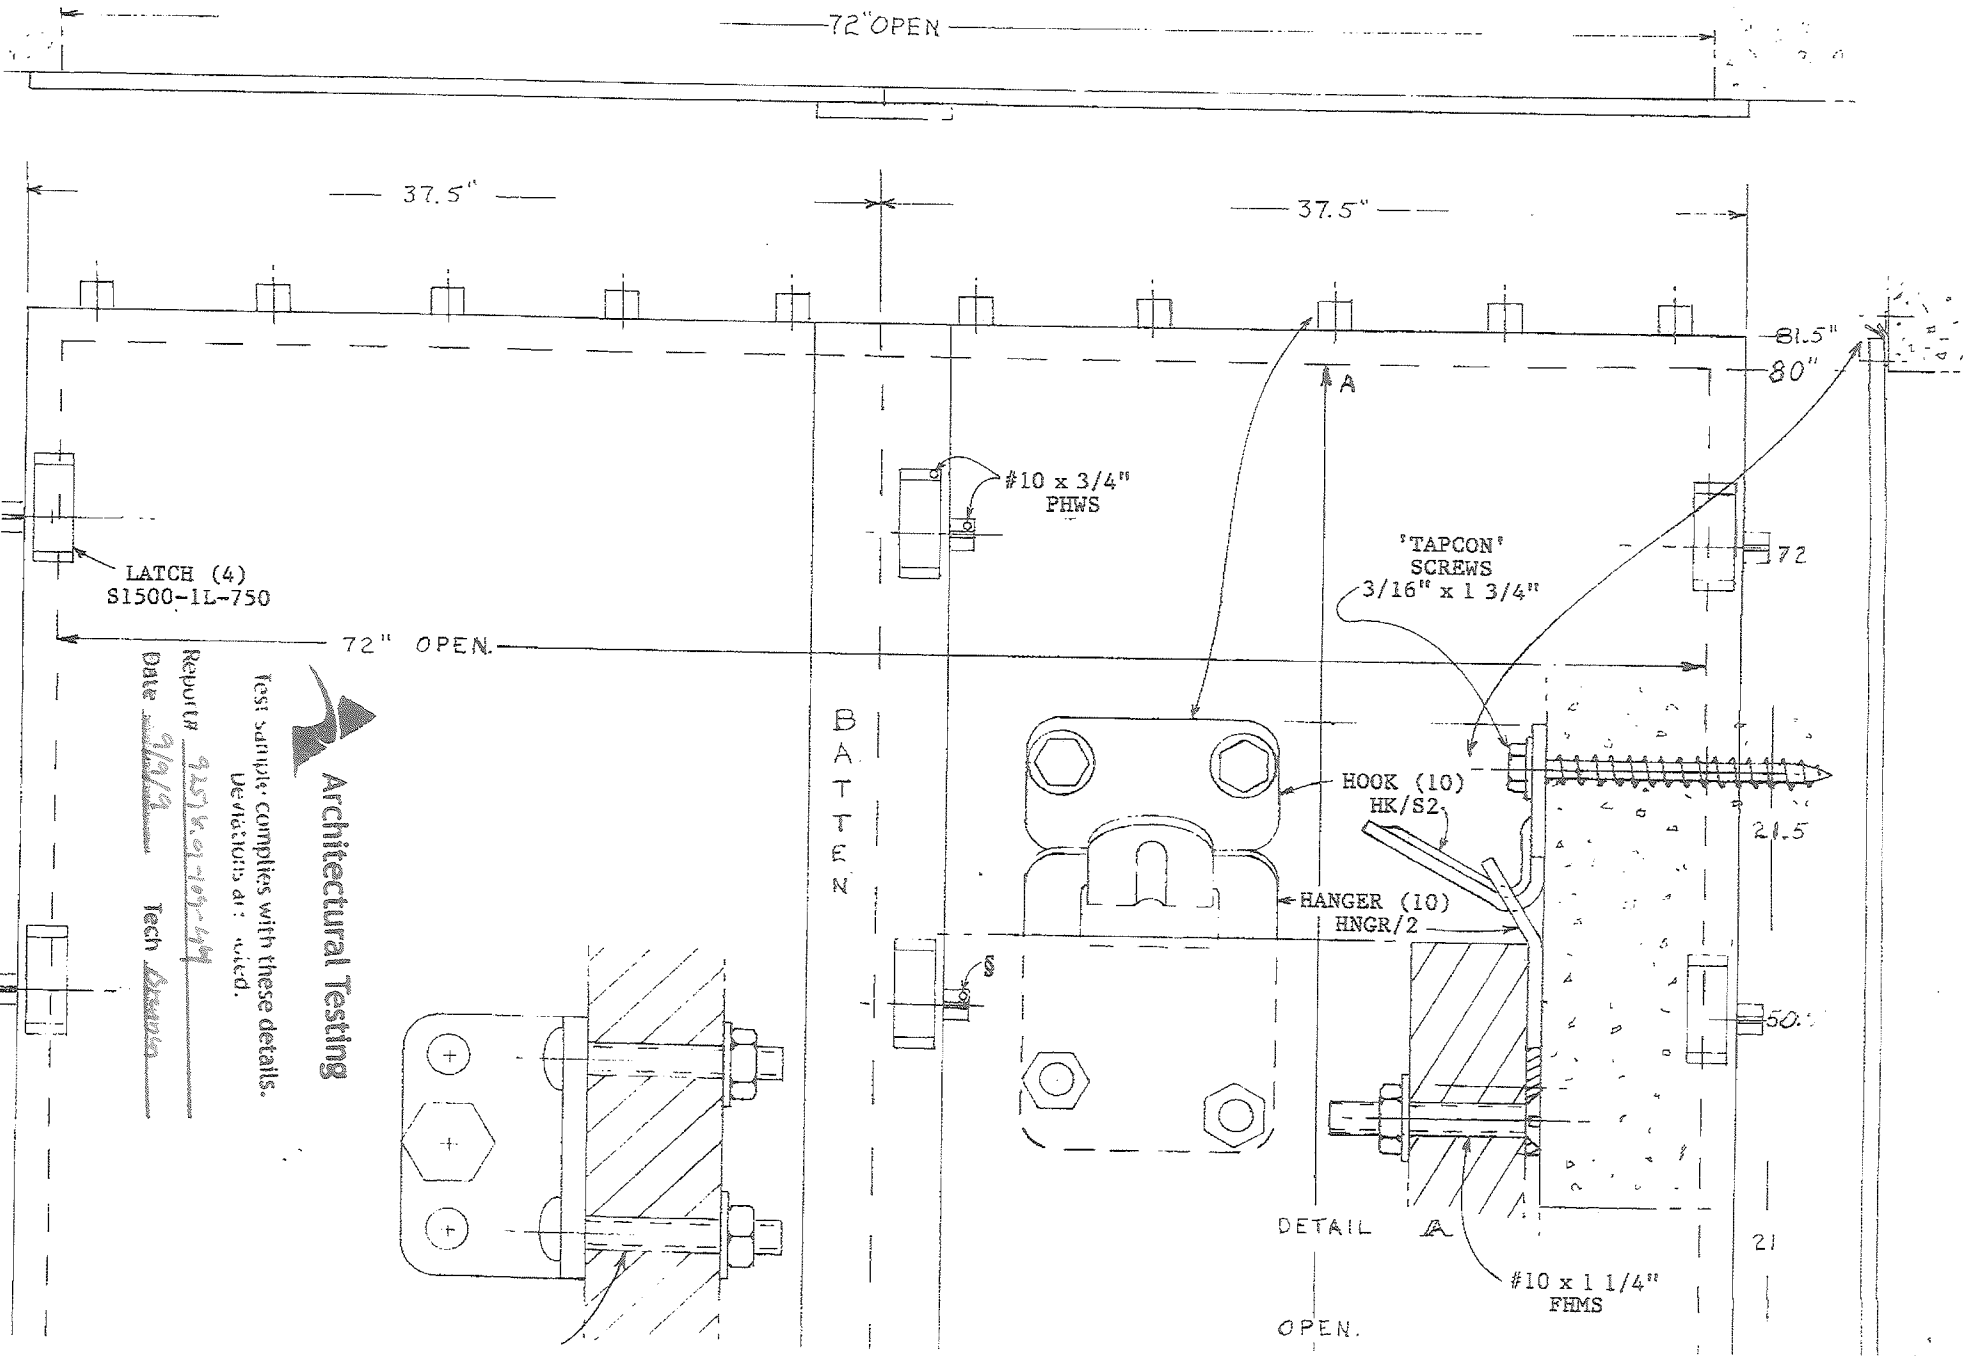

Architectural Testing

Test sample complies with these details. Details are noted.

Report # 92576-01-109-449

Date 9/9/19

Tech *Asmura*

## NORSE LATCHING COMPONENTS, SHUTTER PLYWOOD, & HARDWARE USED FOR FLUSH MOUNTING TEST

ITEM	QUANTITY
#10 x 1 1/4" PHWS/BATTEN	20
*#10 x 3/4" PHWS	80
#10-32 x 1 1/4" PHMS W/NUTS & WASHERS	4
1/4" x 1 1/2" LAG. BOLTS W/ANCHORS	6
'TAPCON' SCREWS 3/4" x 1 3/4"	32

### NORSE HARDWARE

HOOKS (HK/S2)	8
HANGERS (HNG/S2)	8
BIG 'T' RECEIVERS (BOTR-1)/BATTEN	4
SMALL 'T' RECEIVER (OTR187-1)	4
TYPE 1R LATCH (RH-S1500-1R-750)	8
TYPE 1L LATCH (LH-S1500-1L-750)	4
BOTTOM STOP (BS1)	6
PLYWOOD SHUTTERS (5/8" x 36" x 80")	2
BATTEN PLYWOOD (5/8" x 6" x 80")	1
<u>*#10 x 3/4" PHWS:</u>	
LATCHES (12 x 4)	48
BOTTOM STOPS (6 x 2)	12
BIG 'T' AT BATTEN (2 x 2)	4
HANGERS (8 x 2)	16
TOTAL	80





Architectural Testing

Test sample complies with these details.  
Deviations are noted.

Report # 92518. 08-109-99  
Date 9/9/9 Tech Brennan

REF: DWG. B101,294

**TEST CONDUCTED AT ARCHITECTURAL TESTING  
INC, YORK PA THE WEEK OF AUGUST 17, 2009.**

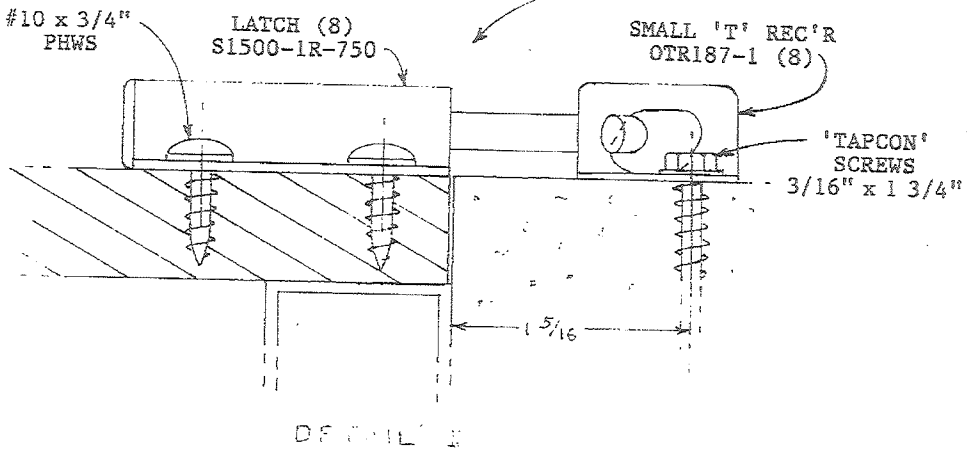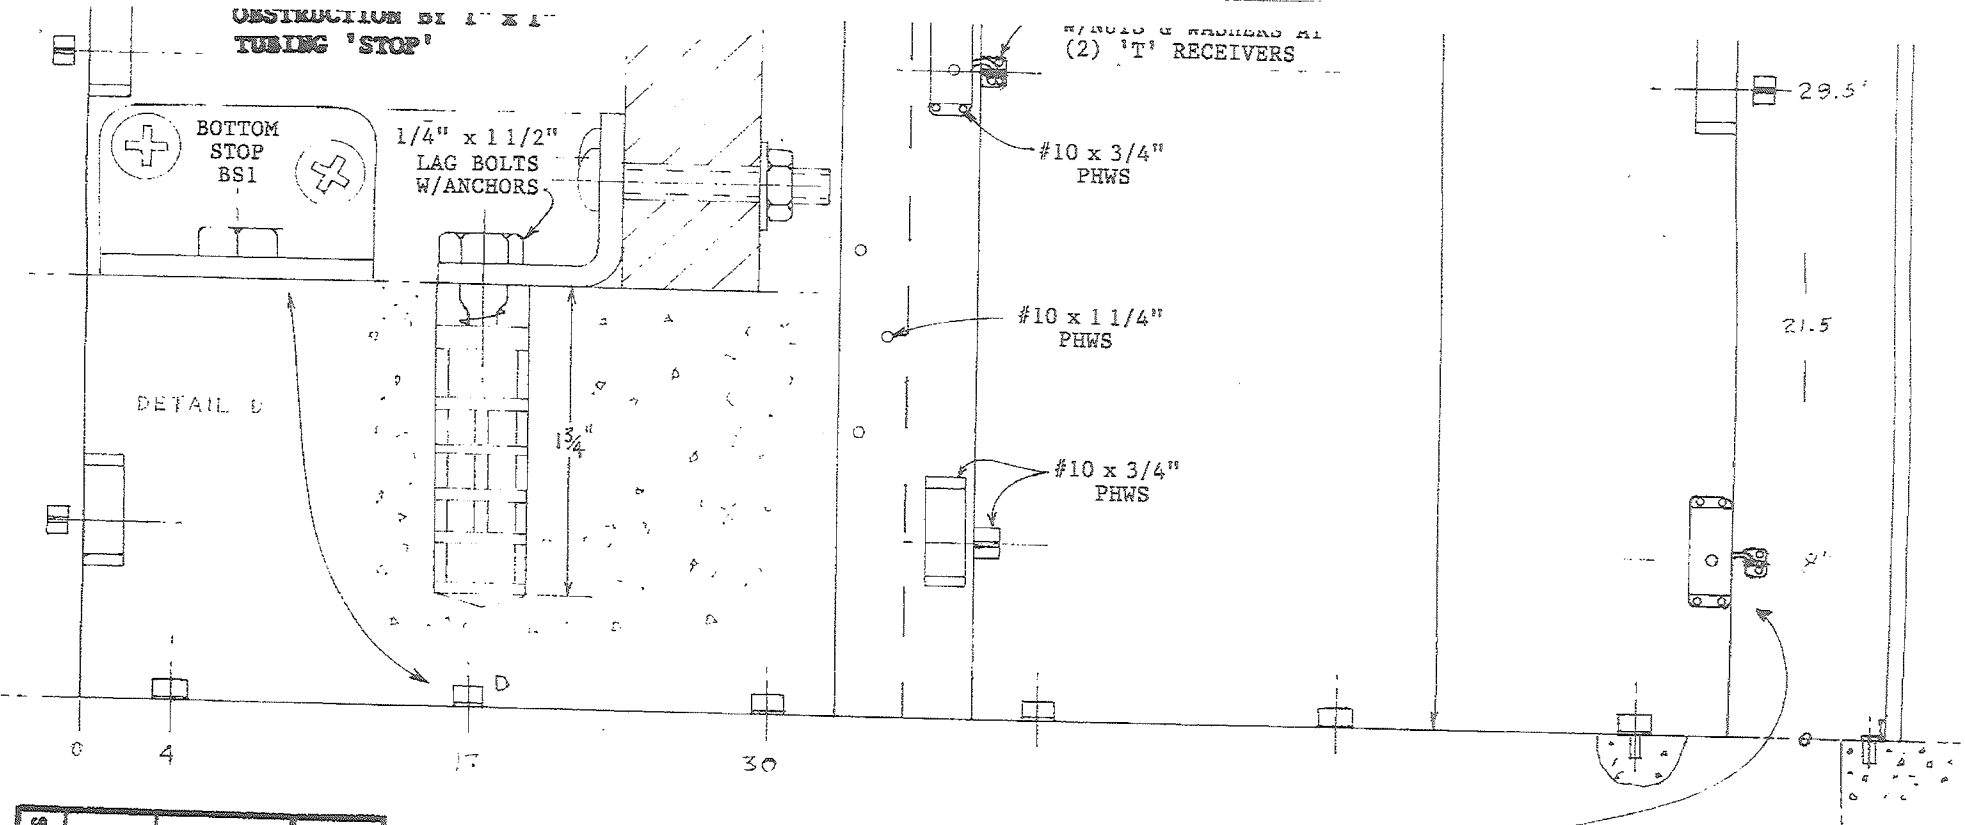


**Architectural Testing**

Test sample complies with these details.  
Deviations are noted.

Report: 92518-9-109-914  
Date: 9/4/9 Tech: Bowers

<p><b>NORSE</b> INC.</p>		<p>72" x 80" TWO PANEL FLUSH MOUNTING HARDWARE</p>	
		<p>CEMENT TEST BUCK</p>	
<p>SCALE 1/8" = 1"</p>	<p>SIZE B</p>	<p>CODE IDENT. NO.</p>	<p>B101,294</p>
<p>26 AUG 09</p>	<p>SHEET</p>		



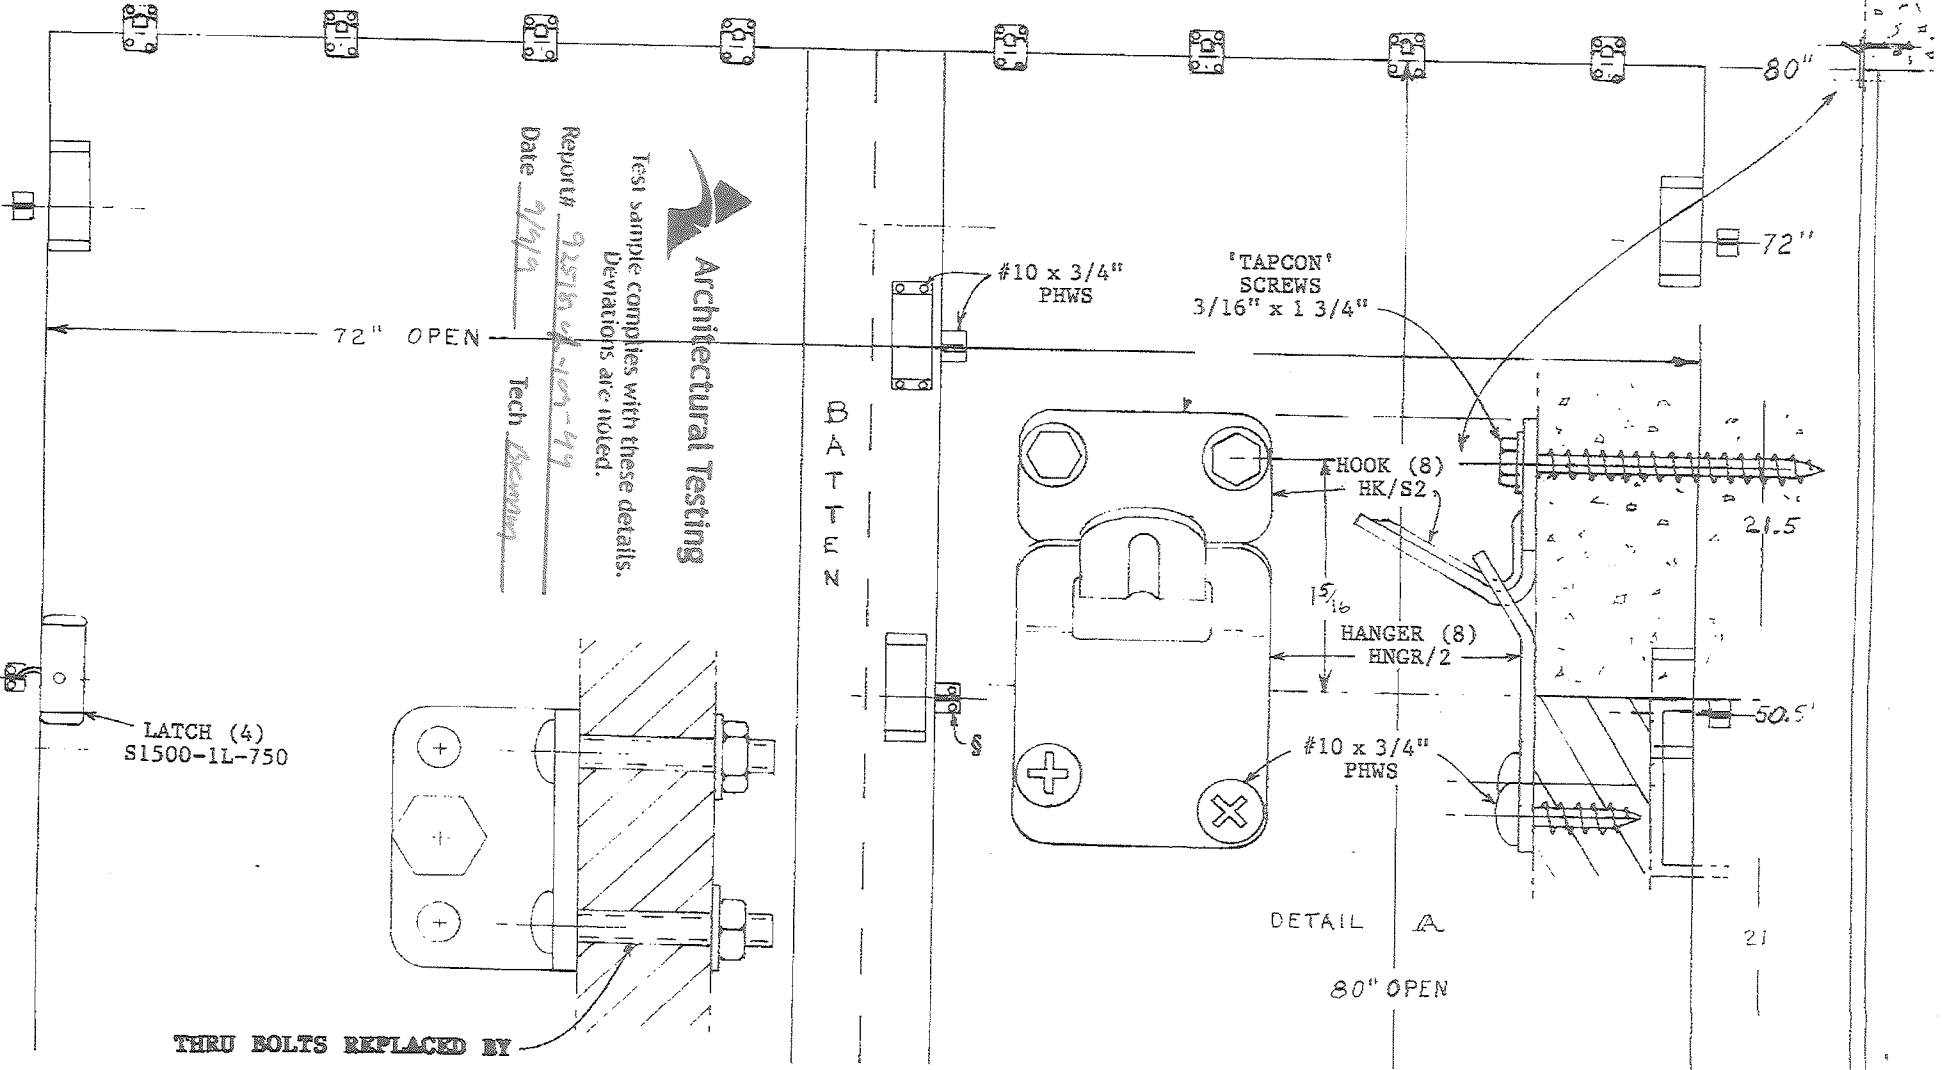

Test sample complies with these details.  
Deviations are noted.

Report# 92516 of 109-44  
Date 9/9/99  
Tech *Beckwith*

THRU BOLTS REPLACED BY